



Clean Air Filter // Quality Tested. Performance Proven.

2203 HWY 59 Po Box 212 Defiance, IA 51527
712 748 3642 cleanairfilter.com

Organic Vapor Filtration Efficiency Testing Report for:

04/18/2018

PN CAF48R


Clean Air Filter
2203 Hwy 59
Defiance Iowa 51527

CAF Staff Ernest Moyer
Mike R Schmitz

TEMP 66.1 F
Humidity 68.0%
Voltage 13.8

CAB Pressure 0.18" H2O
CFM 54.5
HVAC Fan Speed

Cyclohexane Test Challenge at 500 PPM, per EN12941 - Ref: EN15695-2:2016, 3.3.3

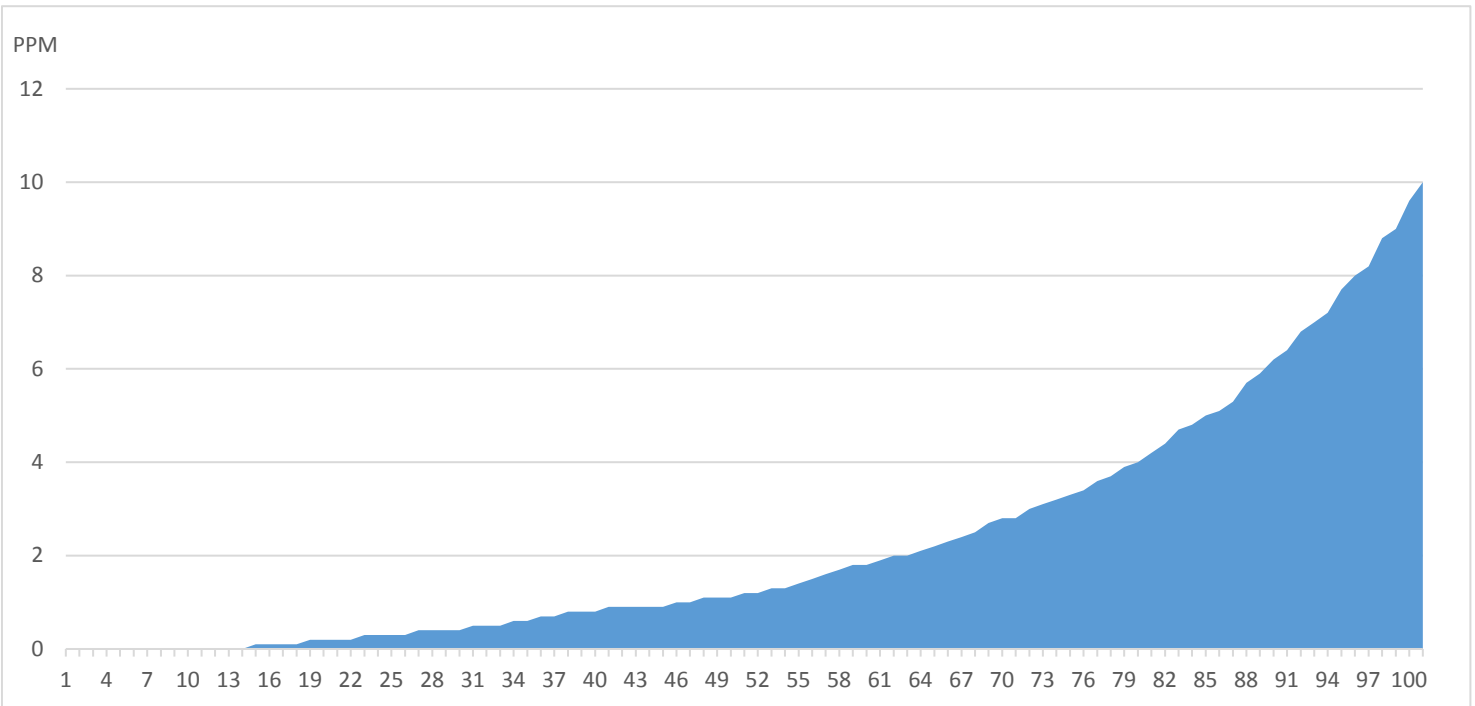

PASSED